

Pre-BID queries response dated 15.04.2023
after published corrigendum-1 dated
24.02.2023 and Pre-BID queries response dated
24.03.2023.

Bid for Request for Proposal (RFP) for the Selection of a System Integrator for implementation (Design, Build, Commission and O&M) of Greenfield State Data Centre (Bid Number: GEM/2022/B/2889326 Dated: 22-12-2022)

Please find the Pre-BID queries response dated 15.04.2023.

All other terms and conditions of the tender would remain the same as in the

- 1) Original published RFP dated 22.12.2022,
- 2) earlier published corrigendum-01 dated 24.02.2023
- 3) Pre-BID queries response dated 24.03.2023.

Contact email-id for queries: dgmTech-gil@gujarat.gov.in/ mgrhninfra1-gil@gujarat.gov.in

For more details visit www.gil.gujarat.gov.in

Pre-bid Queries Clarifications document

for

Request for Proposal (RFP)

**for the Selection of a System
Integrator**

**for implementation (Design, Build,
Commission and O&M) of**

Greenfield State Data Centre

Issued By:



Gujarat Informatics Limited (GIL)

(A Government of Gujarat Undertaking)

On behalf of

**Department of Science & Technology
(DST)**

GIL, Block No. 2, 2nd Floor, C & D Wing, Karmayogi
Bhavan Sector - 10 A, Gandhinagar - 382010 Gujarat

Please find the response to pre-bid queries enclosed
herewith.

For further details visit www.gil.gujarat.gov.in

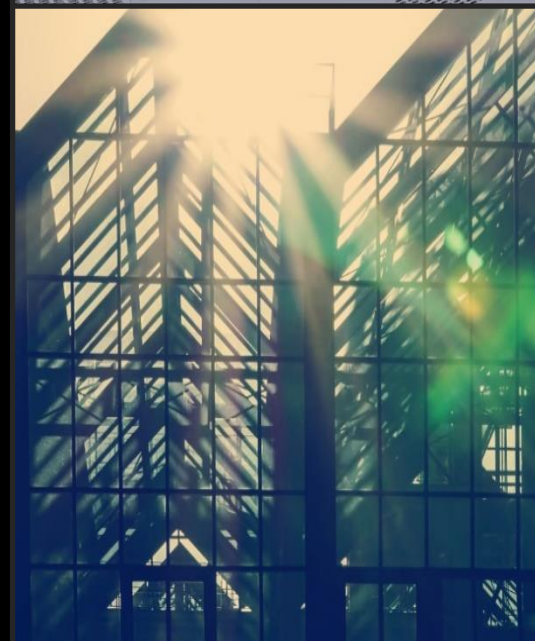


Table of Contents

Section -1 Clarifications on Queries raised 3

Draft

Section -1 Clarifications on Queries raised

Sr. No	Corrigendum / RFP Point No.	Corrigendum / RFP Page No.	Content of the Corrigendum / RFP	Clarification Sought	Tenderer Response
1	Vol2 Section 10.21 Firefighting system	271	Sr. no. 2 Firefighting area wise Solution Sub-point 2 Fire Novec 1230 based Gas system & Sub-point 3 Fire hand extinguisher with clean agent / NOVEC 1230 based	With reference to letter and declaration from 3m , they are discontinues Novec 1230 (Novec 1230 is a Commercial Name of 3M) by end of 2025, So we request to please change and the Gas name as generic FK-5112 42 Bar Clean Agent Gas for Gas Suppression System.	It is recommended that Novec 1230 is referred to in the RFP as a 42 Bar FK 1230 (FK-5-1-12) CLEANAGENT SYSTEM whenever it is appropriate. The Gas quantity calculations needs to be verified by OEMs of Fire System and submit by the bidders along with the technical compliance.
2	Extension	Extension	Extension	We need more time to prepare our comprehensive proposal, structure design and layout with power planning & OEM interlocks for the non-IT components and hence appeal GIL authority to extend bid submission timeline for 2 to 3 weeks more as present timeline will not enough even to comprehend the enormity involved in this project. We are certain that if our request of timeline extension is accepted then more bidders will participate and will generate healthy competition by way of competitive rates among the bidders and will result beneficial to Government to save public money.	As per the GeM Portal

Sr. No	Corrigendum / RFP Point No.	Corrigendum / RFP Page No.	Content of the Corrigendum / RFP	Clarification Sought	Tenderer Response
				Anticipating your help in bid submission timeline extension for 2 to 3 weeks.	
3	Extension	Extension	Extension	Request to you for 3 to 4 week extension for Bid for Request for Proposal (RFP) for the Selection of a System Integrator for implementation (Design, Build, Commission and O&M) of Greenfield State Data Centre (Bid Number: GEM/2022/B/2889326 Dated: 22-12-2022) as it is design build work, we as a bidder need more and sufficient time for Accurate Design to Best design.	As per the GeM Portal
4	Extension	Extension	Extension	We request you for extension as we are working internally for bidding. Being a complexity of RFP and internal approvals we request you for extension till 21st April 2023 for submission.	As per the GeM Portal
5	Vol2 Section 10.21 Firefighting system	271	Sr. no. 2 Firefighting area wise Solution Sub-point 2 Fire Novec 1230 based Gas system & Sub-point 3 Fire hand extinguisher with clean agent / NOVEC 1230 based	While preparation of solution document, it was brought into notice that as per Vol. II, Scope of work – Ch. 10.21 – Firefighting system, Fire Novec 1230 based Gas system is to be deployed at various locations. Novec 1230 is proprietary product of M/s. 3M. As per the declaration letter from 3M dated 20th December 2022 (attached herewith), the product of Novec 1230 will be discontinued by end of 2025. Hence, it is requested to change the gas name as generic FK-5112 Clean Agent Gas for Gas Suppression System.	It is recommended that Novec 1230 is referred to in the RFP as a 42 Bar FK 1230 (FK-5-1-12) CLEANAGENT SYSTEM whenever it is appropriate. The Gas quantity calculations needs to be verified by OEMs of Fire System and submit by the bidders along with the technical compliance.

Sr. No	Corrigendum / RFP Point No.	Corrigendum / RFP Page No.	Content of the Corrigendum / RFP	Clarification Sought	Tenderer Response
				Solicit your kind response at the earliest.	